

25315 - BESD TREMONTON ELEMENTARY
2900 West 500 North Tremonton, UT

Project No. 25315

Addendum

ADD-001.0

To: DWA Construction
76 W 2400 N, North Logan, UT 84341

Reason: Coordination

Date: Fri July 10, 2026

Reference: **EADD-1.0** *Resolut (Formerly VBFA + BNA)*
KADD-1.0 *Jedrzejewski Designs, LLC.*

This Addendum shall be considered part of the Contract Documents and Project Manual for the above mentioned project as though it had been issued at the same time and shall be incorporated integrally therewith. Where provisions of the following supplementary data differ from those of the original Contract Documents and Project Manual, the Addendum shall govern and take precedence.

ADDENDUM 001

PRIOR APPROVALS

- SPEC SECTION 07 5420 THERMOPLASTIC MEMBRANE ROOFING
 - VERSICO ROOF SYSTEMS

END OF ADD-001.0

Issued By: **VCBO Architecture:** Breanna Bonsavage

Approved By: **VCBO Architecture:** Breanna Bonsavage



Jul 10 2026 06:09 PM

cc:

Gerald Jackman
Nathan Tilley
Shane Wilde
Ric Jedrzejewski
Drayton Bailey
Breanna Bonsavage
Justen Christensen
Pamela Irvine

Box Elder School District (BESD)
DWA Construction
DWA Construction
Jedrzejewski Designs, LLC.
Resolut (Formerly VBFA + BNA)
VCBO Architecture
VCBO Architecture
VCBO Architecture

gerald.jackman@besd.net
nathan.t@dwaconstruct.com
shanew@dwaconstruct.com
ricj@jedrzejewskidesigns.com
dbailey@resolutgroup.com
bbonsavage@vcbo.com
jrchristensen@vcbo.com
pirvine@vcbo.com



25315 - BESD TREMONTON ELEMENTARY
2900 West 500 North Tremonton, UT

Project No. 25315

Addendum

EADD-1.0

To: DWA Construction
76 W 2400 N, North Logan, UT 84341

Reason: Coordination

Date: **Fri July 10, 2026**

ADDENDUM 001

PRIOR APPROVALS

- SPEC SECTION 07 5420 THERMOPLASTIC MEMBRANE ROOFING
- VERSICO ROOF SYSTEMS

Electrical:

Electrical Addendum
07/10/2026

See the attached electrical addendum 01 from
Resolut.

END OF EADD-1.0

Issued By: **Resolut (Formerly VBFA + BNA):** Drayton
Bailey

cc:

Gerald Jackman
Nathan Tilley
Shane Wilde
Ric Jedrzejewski
Drayton Bailey
Breanna Bonsavage
Justen Christensen
Pamela Irvine

Box Elder School District (BESD)
DWA Construction
DWA Construction
Jedrzejewski Designs, LLC.
Resolut (Formerly VBFA + BNA)
VCBO Architecture
VCBO Architecture
VCBO Architecture

gerald.jackman@besd.net
nathan.t@dwaconstruct.com
shanew@dwaconstruct.com
ricj@jedrzejewskidesigns.com
dbailey@resolutgroup.com
bbonsavage@vcbo.com
jrchristensen@vcbo.com
pirvine@vcbo.com

RESOLUT

TREMONTON ELEMENTARY SCHOOL

Electrical Addendum #1

Issue Date: 07/08/2026

CHANGES TO THE DRAWINGS:

SHEET E001

1. See clouded areas on sheet attached.

SHEET E003

1. FIXTURE SCHEDULE: Fixtures D4A, descriptions updated added "0-10 DIMMING" and removed "ELV DIMMING."
2. FIXTURE SCHEDULE: Fixtures D4B, descriptions updated added "ELV DIMMING" and removed "0-10 DIMMING."
3. FIXTURE SCHEDULE: Fixtures K4VS, L1AS, L1BS, L2AS, and L2BS descriptions updated added "DALI DRIVER" and removed "0-10 DIMMING."

SHEET E004

1. GENERAL DIAGRAM NOTES: Lighting controls changed from Wattstopper to Lutron.


SHEET E101

1. ELECTRICAL SITE UTILITY COORDINATION: Power Company information has been updated.

POWER COMPANY: Rocky Mountain Power (RMP)
CONTACT: Jennifer Petersen
PHONE NO: 435-563-2953
EMAIL: jennifer.petersen@pacificorp.com
WORK ORDER NO: 7588732."

SHEET E112.3

1. On door 1226B, the door Type was changed from Type "A" to Type "B".

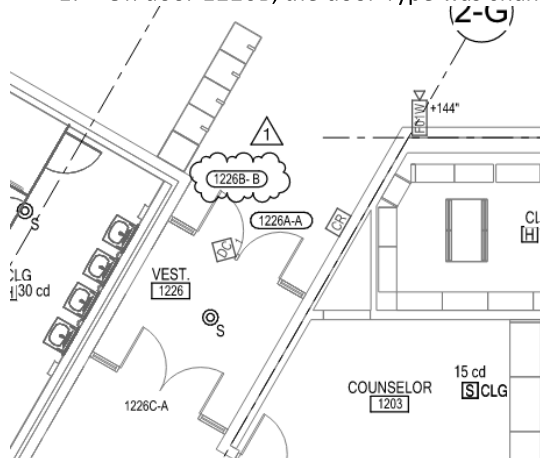

SHEET E116.3


1. Wall mounted camera removed.



TREMONTON ELEMENTARY SCHOOL

Electrical Addendum #1

Issue Date: 07/08/2026

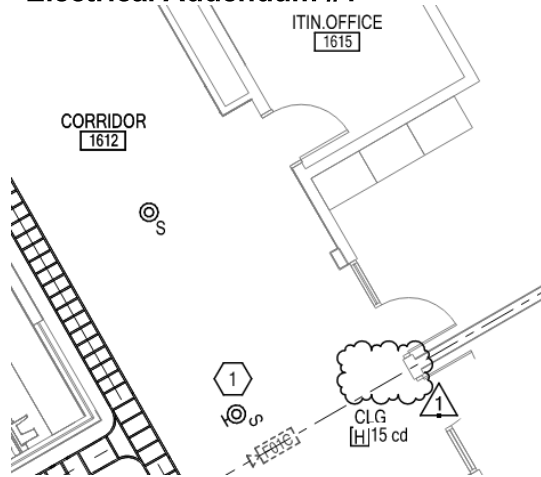

SHEET ET401

1. See clouded areas on sheet attached.

END OF ELECTRICAL ADDENDUM

ABBREVIATIONS INDEX			
ABBREV.	DESCRIPTION	ABBREV.	DESCRIPTION
#	NUMBER	MANHOLE	
AC	ALTERNATING CURRENT	MIC	MICROPHONE
A.F.F.	ABOVE FINISH FLOOR	MIN	MINIMUM
AIC	AMPS INTERRUPTING CAPACITY	MTG	MOUNTING
AM	AMPS METER	MTR	MOTOR
AMP	AMPERE	N/A	NOT APPLICABLE
ANN	ANNUNCIATOR	NC	NORMALLY CLOSED
ATS	AUTOMATIC TRANSFER SWITCH	NEC	NATIONAL ELECTRICAL CODE
AUX	AUXILIARY	NEMA	NATIONAL ELECT. MANUFAC. ASSOC.
AWG	AMERICAN WIRE GAUGE	NFC	NATIONAL FIRE CODE
BC	BARRE COPPER	NFPA	NATIONAL FIRE PROTECTION ASSOC.
BFG	BELOW FINISH GRADE	N.I.C.	NOT IN CONTRACT
C	CONDUIT	NO	NORMALLY OPENED
CAB	CABINET	NTS	NOT TO SCALE
CATB	COMMUNITY ANTENNA TELEVISION	OS & Y	OUTSIDE SCREW & YOKE
CATV	CABLE TELEVISION	PB	PUSHBUTTON
CKT	CIRCUIT	PF	POWER FACTOR
CLG	CEILING	PFR	PHASE FAILURE RELAY
CNTR	CONTRACTOR	PNL	PANEL
C.O.	CONDUIT ONLY	PT	POTENTIAL TRANSFORMER
CRT	COMPUTER TERMINAL	PVC	POLYVINYL CHLORIDE CONDUIT
CT	CURRENT TRANSFORMER	(R)	RELOCATE
CJ	COPPER	RECEP	RECEPTACLE
C/W	COMPLETE WITH	REQ	REQUIREMENT
DB	DECIBEL	RLA	RATED LOAD AMPS
DC	DIRECT CURRENT	RMS	ROOT MEAN SQUARE
DWG	DRAWING	SE	SERVICE ENTRANCE
(E)	EXISTING	SPEC	SPECIFICATIONS
EC	EMPTY CONDUIT	SPKR	SPEAKER
EG	EMERGENCY GENERATOR	SS	SELECTOR SWITCH
EMT	ELECTRICAL METALLIC TUBING	SW	SWITCH
EX	EXPLOSION PROOF	SWBD	SWITCHBOARD
FACP	FIRE ALARM CONTROL PANEL	SWGR	SWITCHGEAR
FC	FOOT CANDLE	TTB	TELEPHONE TERMINAL BOARD
FT	FOOT	TTC	TELEPHONE TERMINAL CABINET
GFI	GROUND FAULT INTERRUPTER	TV	TELEVISION
GND	GROUND	TYP	TYPICAL
GRC	GALVANIZED RIGID CONDUIT	UG	UNDERGROUND
HP	HORSE POWER	UP	UTAH POWER
HZ	HERTZ	UPS	UNINTERRUPTED POWER SUPPLY
IG	ISOLATED GROUND	V	VOLT (KV=KILOVOLT)
IMC	INTERMEDIATE METALLIC CONDUIT	VAR	VOLT-AMPS/REACTIVE
IN	INCH	VM	VOLT METER
J-BOX	JUNCTION BOX	W	WATTS
KV	KILOVOLT	W	WITH
KVA	KILOVOLT AMPERES	WH	WATTHOUR METER
KVAR	KILOVARS	WO	WITHOUT
KW	KILOWATT	WP	WEATHERPROOF
LRA	LOCKED ROTOR AMPS	XFMR	TRANSFORMER
LTG	LIGHTING	XFMR SW	TRANSFER SWITCH
MNF	MANUFACTURER	XP	EXPLOSION PROOF
MATV	MASTER ANTENNA TELEVISION	1P	SINGLE-PHASE
MAX	MAXIMUM	2P	TWO-POLE
MB	MAIN BUS	3P	THREE-POLE
MCC	MOTOR CONTROL CENTER	4P	FOUR-POLE
MCM	1000 CIRCULAR MILLS	Ø	PHASE

SHEET KEYNOTES

1. RECESSED CEILING CORD REEL: PROVIDE A RECESSED CORD REEL ASSEMBLY FLUSH-MOUNTED IN THE CEILING. THE ASSEMBLY SHALL CONSIST OF A HUBBEL #HBL44123R220M1 CORD REEL INSTALLED WITHIN A HUBBEL #HBLPRBOX PLENUM-RATED RECESSED ENCLOSURE (OR APPROVED EQUIVALENTS). THE ELECTRICAL CONTRACTOR SHALL VERIFY THE EXACT MOUNTING LOCATION, CEILING TYPE, AND ABOVE-CEILING CLEARANCE REQUIREMENTS PRIOR TO ROUGH-IN. STRICTLY COORDINATE CEILING CUTOUTS AND ADDITIONAL FRAMING SUPPORT WITH THE GENERAL AND CEILING CONTRACTORS TO ENSURE A SECURE INSTALLATION. PROVIDE ALL ASSOCIATED LINE-VOLTAGE WIRING, MOUNTING HARDWARE, AND ACCESSORIES REQUIRED FOR A COMPLETE AND FULLY OPERATIONAL SYSTEM.

ROOFING GENERAL NOTES

1. CONTRACTOR SHALL NOT INSTALL ELECTRICAL CONDUIT(S) THROUGH THE NEW MECHANICAL CURB AND/OR DUCTWORK. LOCATE ELECTRICAL CONDUITS A MINIMUM OF 12" AWAY FROM MECHANICAL CURB ALONG WITH MAINTAINING A MINIMUM OF 12" BETWEEN ANY CONDUIT AND ANY OTHER OBSTACLE. CONDUITS MUST EXTEND 24" FROM DECK WITH 16"-18" OF CONDUIT PROTRUDING FROM FINISHED ROOF LINE. COORDINATE ANY AND ALL OTHER REQUIRED ROOFING REQUIREMENTS WITH OWNER PRIOR TO ROUGH-IN.

CONTROLS ROUGH-IN NOTES

1. ATC CONDUIT BY DIVISION 26:
THE ELECTRICAL CONTRACTOR (DIV 26) SHALL PROVIDE A COMPLETE RACEWAY SYSTEM FOR ALL THE AUTOMATIC TEMPERATURE CONTROL (ATC) SYSTEM E.G., THIS INCLUDES ALL REQUIRED OUTLET BOXES, METAL CONDUIT, FITTINGS, AND SUPPORTS.
2. MINIMUM SIZING & TYPE:
PROVIDE 3/4" MINIMUM TRADE SIZE EMT FOR ALL CONTROL PATHWAYS UNLESS OTHERWISE NOTED. SURFACE MOUNTED RACEWAY IS STRICTLY PROHIBITED IN FINISHED AREAS.
3. WIRING RESPONSIBILITY:
ALL LOW VOLTAGE CONTROL WIRING SHALL BE FURNISHED AND INSTALLED BY THE ATC CONTRACTOR IN ACCORDANCE WITH NEC AND DIVISION 26 STANDARDS. ELECTRICAL CONTRACTOR SHALL PROVIDE PULL STRINGS IN ALL EMPTY CONDUITS.
4. THERMOSTAT/SENSOR COORDINATION:
A. ALIGNMENT: THERMOSTATS SHALL BE VERTICALLY ALIGNED WITH ADJACENT LIGHTING CONTROL DEVICES, WHERE LOCATED WITHIN 2'-0" OF A LIGHT SWITCH, ALIGN CENTERLINE OF THERMOSTAT WITH CENTERLINE OF SWITCH. B. HEIGHT: MOUNT ALL THERMOSTATS AT 48" AFF (TO TOP OF DEVICE) TO ENSURE ADA COMPLIANCE, UNLESS OTHERWISE NOTED. C. BOXES: PROVIDE 4" SQUARE DEEP BOX WITH SINGLE-GANG MUD RING FOR ALL SENSORS. DO NOT USE "HANDY BOXES" WITHOUT VERIFYING DEVICE WIDTH WITH CONTROLS CONTRACTOR.
5. COORDINATION REQUIRED:
PRIOR TO ROUGH-IN, THE ELECTRICAL CONTRACTOR SHALL COORDINATE EXACT PATHWAY REQUIREMENTS, DEVICE LOCATIONS, AND CONDUIT QUANTITIES WITH THE ATC CONTRACTOR AND RELEVANT DIVISION 23/25 DOCUMENTS.
6. SUBMITTAL VERIFICATION:
ELECTRICAL CONTRACTOR SHALL OBTAIN AND REVIEW ATC EQUIPMENT SUBMITTALS PRIOR TO INSTALLATION. CONTRACTOR ASSUMES FINAL RESPONSIBILITY FOR COORDINATING BLOCKOUTS, PENETRATIONS, AND INTERFACES BETWEEN TRADES. REPORT ANY DISCREPANCIES BETWEEN CONTRACT DOCUMENTS AND MANUFACTURER SUBMITTALS TO THE ENGINEER IMMEDIATELY.

TELEPHONE/DATA LEGEND

DIVISION 26000, 27, AND 28 ELECTRICAL CONTRACTORS ARE RESPONSIBLE TO READ, UNDERSTAND AND ABIDE TO THE SPECIFICATIONS OF DIVISION 27 1500 CONTRACTOR'S RESPONSIBILITY AND THE SCOPE OF THE WORK THAT IS BEING REQUIRED. REFER TO DRAWINGS AND SPECIFICATIONS FOR ANY ADDITIONAL REQUIRED DROPS AND FURTHER INFORMATION.

- ▼ R OUTLET: 1 DATA
▼ X OUTLET: 2 DATA
▼ Y OUTLET: 3 DATA
▼ Z OUTLET: 4 DATA
▼ L-X OUTLET: # CABLES PER "X" e.g. L-2 = 2 DATA
▼ T OUTLET: 1 PHONE
[T] (L-X) FLOOR BOX: OUTLET: # CABLES PER "X" e.g. (L-2) = 2 DATA
[L] (L-1) FLAT PANEL DISPLAY BOX: # CABLES PER "X" e.g. (L-1) = 1 DATA
[L] (L-1) IP ADDRESSABLE INTERCOM SPEAKER: 1 DATA (REFER TO ET SHEETS/27 5123)

TELEPHONE/DATA LEGEND

DIVISION 26, 27, & 28 CONTRACTORS ARE RESPONSIBLE TO READ, UNDERSTAND AND ABIDE TO THE SPECIFICATIONS OF DIVISION 27 1500 CONTRACTOR'S RESPONSIBILITY AND THE SCOPE OF THE WORK THAT IS BEING REQUIRED. REFER TO DRAWINGS AND SPECIFICATIONS FOR ANY ADDITIONAL REQUIRED DROPS AND FURTHER INFORMATION.


- CEILING MOUNTED OUTLET: REFER TO LETTER FOR CABLE QUANTITY
WIRELESS ACCESS POINT: PROVIDE (2) SHIELDED CAT6A DATA CABLES WITH 2 PORT SURFACE BOX (1X COIL ABOVE CEILING); WAP UNIT IS OFOI.
FLOOR BOX: REFER TO DESCRIPTION FOR # CABLES REQUIRED AT EACH FLOOR BOX.
FLAT PANEL DISPLAY BOX: PROVIDE (2) DATA DROP UNLESS NOTED OTHERWISE.
PROVIDE ONE (1) SPECIFIED YELLOW JACKETED, PLENUM RATED CAT6 CATEGORY CABLE TO EACH IP SURVEILLANCE CAMERA LOCATION. ALL OF THE ACTIVE IP VIDEO SURVEILLANCE EQUIPMENT WILL BE OWNER FURNISHED, AND THE IP SURVEILLANCE CAMERAS WILL BE INSTALLED BY THE CONTRACTOR.
AV CLASSROOM ENHANCEMENT CAMERA: PROVIDE (1) CAT6A CATEGORY CABLE (REFER TO THE AUDIOVISUAL PLAN SHEETS)
IP TWO-WAY AUDIO/VIDEO INTERCOM DOOR STATIONS & ANSWERING BASE STATIONS. (REFER TO THE SYSTEM PLAN SHEETS)
PROJECTOR CEILING MOUNT AND RECESSED EQUIPMENT RACK LOCATION. REFER TO ET SERIES SHEETS FOR LOCATION OF PROJECTOR AND/OR EQUIPMENT RACK. PROVIDE SURGE PROTECTED OUTLET AND DATA AS INDICATED. (# CABLES PER "X" e.g. (L-1) = 1 DATA)
VAPE SENSOR: PROVIDE (1) CATEGORY CABLE (REFER TO THE SYSTEM PLAN SHEETS) (ALL OF THE ACTIVE VAPE SENSOR EQUIPMENT WILL BE OWNER FURNISHED, AND OWNER INSTALLED)
AV IP INTERCOM SPEAKER: 1 DATA (REFER TO INTERCOM TA400 SHEETS)
IP CLASSROOM SOUND AMPLIFICATION SYSTEM: 1 DATA (REFER TO AV SHEETS)

1. ALL CABLE PATHWAYS (CONDUIT, CABLE TRAY, ETC.) TO BE INSTALLED BY DIVISION 26000 CONTRACTORS WHEN INDICATED ON THE DRAWINGS AND/OR IN THIS SPECIFICATION. CABLE TRAY IS NOT TO BE ANY LESS THAN 18" WIDE AND 4" HIGH THROUGH MAIN CORRIDOR PATHWAYS. CONTRACTORS TO INSTALL A 4-11/16" SQUARE DEEP BOX WITH A SINGLE MINIMUM 1" CONDUIT ENTRY TO EACH NETWORK DROP
2. REFER TO THE SPECIFICATIONS FOR THE DIFFERENT CATEGORY CABLE SERVICE LOOP LENGTH REQUIREMENTS. PROVIDE LABELING ON BOTH ENDS OF ALL CATEGORY CABLES. INSTALL THE CATEGORY CABLE IN ACCORDANCE WITH BICSI BEST PRACTICES AND TEST ALL CATEGORY CABLES IN ACCORDANCE WITH APPLICABLE ANSI/TIA STANDARDS.
3. ANY PATHWAYS IN OR UNDER THE SLAB OR ANY OTHER POTENTIALLY WET LOCATIONS SHALL USE THE APPROPRIATE OSP CABLEING AND CONDUIT SHALL RUN TO THE NEAREST NETWORK CLOSET WHERE CABLES WILL BE TERMINATED WITHIN 50' OF EXITING THE CONDUIT. ANY PIPING OF THESE LOCATIONS TO THE CABLE TRAY SO THAT OSP CABLES WOULD RUN FREELY THROUGH A PLENUM AIR SPACE IS PROHIBITED.

SHEET INDEX

- SYMBOLS, SCHEDULES AND NOTES
SCHEDULES AND NOTES
E101 ELECTRICAL SITE PLAN
E102 ELECTRICAL DISTRIBUTION PLAN LEVEL 1
E1101 LIGHTING PLAN - LEVEL 01 - AREA 1
E1112 POWER PLAN - LEVEL 01 - AREA 1
E1113 SYSTEMS PLAN - LEVEL 01 - AREA 1
E1121 LIGHTING PLAN - LEVEL 01 - AREA 2
E1122 POWER PLAN - LEVEL 01 - AREA 2
E1123 SYSTEMS PLAN - LEVEL 01 - AREA 2
E1131 LIGHTING PLAN - LEVEL 01 - AREA 3
E1132 POWER PLAN - LEVEL 01 - AREA 3
E1133 SYSTEMS PLAN - LEVEL 01 - AREA 3
E1141 LIGHTING PLAN - LEVEL 01 - AREA 4
E1142 POWER PLAN - LEVEL 01 - AREA 4
E1143 SYSTEMS PLAN - LEVEL 01 - AREA 4
E1151 LIGHTING PLAN - LEVEL 01 - AREA 5
E1152 POWER PLAN - LEVEL 01 - AREA 5
E1153 SYSTEMS PLAN - LEVEL 01 - AREA 5
E1161 LIGHTING PLAN - LEVEL 01 - AREA 6
E1162 POWER PLAN - LEVEL 01 - AREA 6
E1163 SYSTEMS PLAN - LEVEL 01 - AREA 6
E103 ELECTRICAL DISTRIBUTION PLAN LEVEL 2
E1221 LIGHTING PLAN - LEVEL 02 - AREA 2
E1222 POWER PLAN - LEVEL 02 - AREA 2
E1223 SYSTEMS PLAN - LEVEL 02 - AREA 2
E201.1 TYPICAL CLASSROOM LIGHTING LAYOUTS
E201.2 TYPICAL CLASSROOM POWER LAYOUTS
E202.1 ENLARGED KITCHEN POWER PLAN
E202.2 ENLARGED VIEWS POWER PLAN
E301 ONE-LINE DIAGRAM
E302 PANELBOARD SCHEDULES
E303 PANELBOARD SCHEDULES
E304 PANELBOARD SCHEDULES
E305 PANELBOARD SCHEDULES
E401 ELECTRICAL DIAGRAMS
E402 ELECTRICAL DIAGRAMS
E403 ELECTRICAL DIAGRAMS
E404 ELECTRICAL DIAGRAMS
E405 ELECTRICAL DIAGRAMS
E406 ELECTRICAL DIAGRAMS
ET001 AUDIOVISUAL SYMBOLS, SCHEDULES, AND NOTES
ET111.1 AUDIOVISUAL PLAN - LEVEL 01 - AREA 1
ET112.1 AUDIOVISUAL PLAN - LEVEL 01 - AREA 2
ET113.1 AUDIOVISUAL PLAN - LEVEL 01 - AREA 3
ET114.1 AUDIOVISUAL PLAN - LEVEL 01 - AREA 4
ET115.1 AUDIOVISUAL PLAN - LEVEL 01 - AREA 5
ET116.1 AUDIOVISUAL PLAN - LEVEL 01 - AREA 6
ET122.1 AUDIOVISUAL PLAN - LEVEL 02 - AREA 2
ET202 INTERCOM PLAN - LEVEL 01
ET203 INTERCOM PLAN - LEVEL 02
ET401 AUDIOVISUAL DIAGRAMS

CAMERA SURVEILLANCE TAG LEGEND

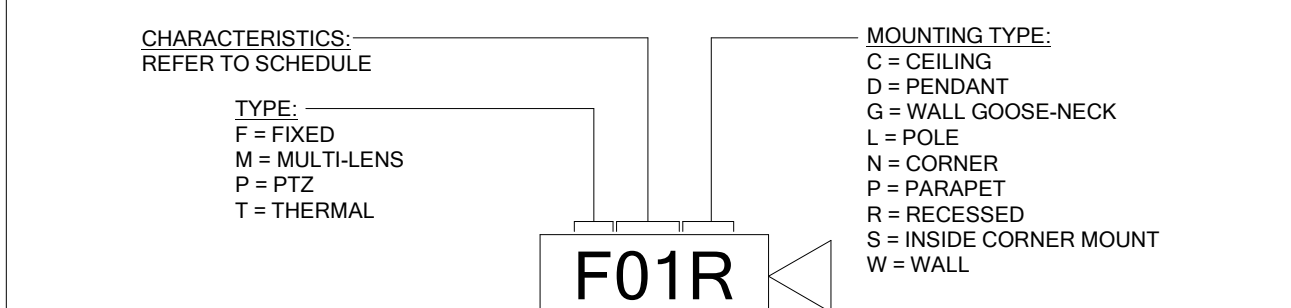


SEE THE "CAMERA SURVEILLANCE SCHEDULE" FOR CAMERA TYPES

ACCESS CONTROL TYPE SCHEDULE

LEGEND:									
CR = ACCESS CONTROL CREDENTIAL CARD...		KCR ACCESS CONTROL CREDENTIAL CARD READER...			DC ACCESS CONTROL DOOR / WINDOW / CONTACT				
BR = ACCESS CONTROL BIOMETRIC READER...		ICR INTEGRATED LOCKSET WITH CREDENTIAL CARD READER			DP = INTRUSION DETECTION DOOR / WINDOW CONTACT				
DOOR DESCRIPTION		CREDENTIAL				DOOR CONTACT		NOTES	
TYPE		CR	BR	KCR	ICR	DC	DP		
A	SINGLE DOOR	1	0	0	0	1	0	REFER TO THE SECURITY GENERAL NOTES	
B	SINGLE DOOR	0	0	0	0	1	0	REFER TO THE SECURITY GENERAL NOTES	
C	DOUBLE DOOR	1	0	0	0	2	0	REFER TO THE SECURITY GENERAL NOTES	
D	DOUBLE DOOR	0	0	0	0	2	0	REFER TO THE SECURITY GENERAL NOTES	
E	SINGLE DOOR	2	0	0	0	1	0	REFER TO THE SECURITY GENERAL NOTES	
G	GARAGE DOOR	0	0	0	0	1	0	REFER TO THE SECURITY GENERAL NOTES	
R	ROOF ACCESS HATCH	0	0	0	0	1	0	REFER TO THE SECURITY GENERAL NOTES	

ACCESS CONTROL TAG LEGEND

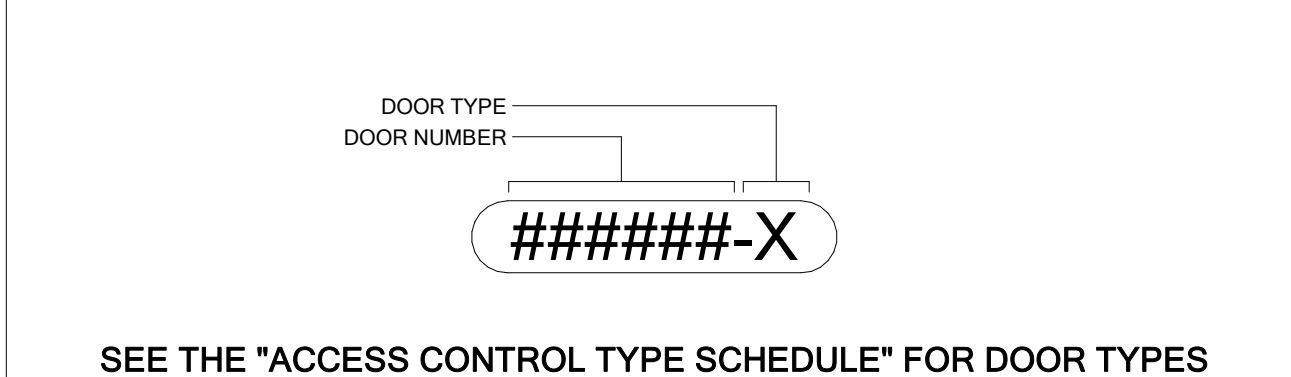

ELECTRICAL SYMBOL SCHEDULE

STANDARD MOUNTING HEIGHT UNLESS OTHERWISE NOTED ON PLANS			
SYMBOL	DESCRIPTION	MOUNTING HEIGHT	NOTES
○	ONE CIRCUIT, HOME RUN TO PANEL		
○	2 CIRCUIT, HOME RUN TO PANEL		
○	3 CIRCUIT, HOME RUN TO PANEL		
○	CONDUIT RUN CONCEALED IN WALL OR CEILING		
○	CONDUIT RUN CONCEALED IN FLOOR OR GROUND		
○	CONDUIT UP		
○	CONDUIT DOWN		
○	CONDUIT STUB LOCATION		
○	CONDUIT/CIRCUIT CONTINUATION		
○	CABLE TRAY	AS NOTED	
○	CEILING LIGHT FIXTURE	CEILING	1.
○	WALL LIGHT FIXTURE	AS NOTED	1.
○	RECESSED DOWNLIGHT FIXTURE	CEILING	1.
○	RECESSED WALLWASH DOWNLIGHT FIXTURE	CEILING	1.
○	LIGHT FIXTURE	AS NOTED	1.
○	EGRESS LIGHT FIXTURE	AS NOTED	UNSWITCHED HOT REQ. SEE DIAGRAM
○	AREA LIGHT POLE AND FIXTURE	CONCRETE BASE	SEE DIAGRAM
○	FLOOD OR TRACK FIXTURE	AS NOTED	
○	CEILING/WALL MOUNTED EXIT LIGHT	CEILING/AS NOTED	1.3.8.
○	THREE-WAY SWITCH	+46"	2.4.
○	FOUR-WAY SWITCH	+46"	2.4.
○	KEY OPERATED SWITCH	+46"	2.4.
○	SWITCH WITH PILOT LIGHT	+46"	2.4.
○	VARIABLE INTENSITY SWITCH	+46"	2.4.
○	TIMER SWITCH	+46"	2.4.
○	MOMENTARY CONTACT SWITCH	+46"	2.4.
○	WIRELESS WALLSTATION / PICO REMOTE (SUBSCRIPT INDICATES CONFIGURATION & CONTROL SEQUENCE)	+46"	2. SEE DIAGRAM, SPEC.
○	WIRELESS CEILING MOUNTED OCCUPANCY SENSOR (PIR OR DUAL TECH). COORDINATE EXACT PLACEMENT WITH MFR		SEE DIAGRAM, SPEC.
○	DUAL TECH. WALL MOUNTED OCCUPANCY SENSOR (SUBSCRIPT D = DIMMING AND DAYLIGHT CONTROL)	+46"	2.4. SEE DIAGRAM SPEC.
○	LUTRON POWPAK (SUBSCRIPT INDICATES CONTROL/ZONE)	ABOVE CEILING	SEE DIAGRAM, SPEC.
○	LUTRON VIVE HUB. MOUNT FLUSH TO CEILING. PROVIDE DEDICATED 120V CIRCUIT (EMERGENCY BACKUP PREFERRED) PROVIDE DATA DROP FOR CONNECTION TO CAMPUS IT NETWORK.	FLUSH TO CEILING	SEE DIAGRAM, SPEC.
○	LUTRON UL924 EMERGENCY POWPAK (SUBSCRIPT INDICATES CONTROL/ZONE)	ABOVE CEILING	SEE DIAGRAM, SPEC.
○	PHOTO-ELECTRIC CONTROL		MOUNT AS PER. MFR.
○	WIRELESS DAYLIGHT SENSOR. MOUNT 1 TO 2 DIAMETERS FROM WINDOW HEIGHT AWAY FROM WINDOW	CEILING	SEE DIAGRAM, SPEC.
○	DUPLEX RECEPTACLE	+16" OR AS NOTED	9. 11.
○	DUPLEX RECEPTACLE WITH USB OUTLET	+16" OR AS NOTED	9. 11.
○	DUPLEX RECEPTACLE		9.
○	ELECTRIC WATER COOLER RECEPTACLE 5mA GFCI BRK		SEE DIAGRAM R002/E404
○	WEATHERPROOF RECEPTACLE	+24" OR AS NOTED	2. 9.
○	GROUND FAULT INTERRUPTER DUPLEX RECEPTACLE	+16" OR AS NOTED	9. 11.
○	DUPLEX RECEPTACLE EMERGENCY POWER (RED)	+16" OR AS NOTED	9. 11.
○	FOURPLEX RECEPTACLE	+16" OR AS NOTED	9. 11.
○	GROUND FAULT INTERRUPTER FOURPLEX RECEPTACLE	+16" OR AS NOTED	9. 11.
○	FOURPLEX RECEPTACLE EMERGENCY POWER (RED)	+16" OR AS NOTED	9. 11.
○	SPD PROTECTED RECEPTACLE	+16" OR AS NOTED	9. 11.
○	SPECIAL PURPOSE OUTLET	AS NOTED	10. WITH CAP. 11
○	FLAT PANEL DISPLAY WALL BOX. INCLUDES: (1) SPD RECP. (1) DATA DROP (UNLESS NOTED OTHERWISE PER LEGEND)	AS NOTED ABOVE CEILING	SEE DIAGRAM, SPEC.
○	DATA OUTLET, SEE LEGEND FOR CABLE # REQ.	+16" OR AS NOTED	9. 11.
○	WIRELESS ACCESS POINT, SEE LEGEND	CEILING	
○	AV DATA DROP, REFER TO LEGEND BELOW	+16" OR AS NOTED	9. 11. 13.
○	RECEPTACLE CORD REEL	CEILING	①

TYPE	DESCRIPTION	MANFR.	CAT. No.	NOTES
F01C	12MP DAY/NIGHT OUTDOOR/INDOOR FISHEYE CAMERA - CEILING MOUNTED	HANWHA	XNF-9013RV	REFER TO THE SECURITY GENERAL NOTES
F01N	12MP DAY/NIGHT OUTDOOR/INDOOR FISHEYE CAMERA - CORNER MOUNTED	HANWHA	XNF-9013RV	REFER TO THE SECURITY GENERAL NOTES
F01W	12MP DAY/NIGHT OUTDOOR/INDOOR FISHEYE CAMERA - WALL MOUNTED	HANWHA	XNF-9013RV	REFER TO THE SECURITY GENERAL NOTES
F02N	4K AI DAY/NIGHT OUTDOOR/INDOOR VARIFOCA DOME CAMERA - CORNER MOUNTED	HANWHA	XNV-9003R	REFER TO THE SECURITY GENERAL NOTES
F02W	4K AI DAY/NIGHT OUTDOOR/INDOOR VARIFOCA DOME CAMERA - WALL MOUNTED	HANWHA	XNV-9003R	REFER TO THE SECURITY GENERAL NOTES
F04W	4K AI DAY/NIGHT OUTDOOR/INDOOR VARIFOCA DOME CAMERA - WALL MOUNTED	HANWHA	PNV-A9081R	REFER TO THE SECURITY GENERAL NOTES
M02W	15MP PANORAMIC DAY/NIGHT OUTDOOR/INDOOR DOME CAMERA - WALL MOUNTED	HANWHA	PNM-9031RV	REFER TO THE SECURITY GENERAL NOTES

CAMERA SURVEILLANCE SCHEDULE

1. SEE FIXTURE SCHEDULE FOR TYPE, MOUNTING AND WATTAGE.
2. HEIGHT MEASURED TO CENTER LINE OF THE BOX FROM THE FINISH FLOOR.
3. REFER TO DRAWINGS FOR DIRECTIONAL ARROWS.
4. SUBSCRIPT KEYS SWITCH TO FIXTURES CONTROLLED.
5. NEMA TYPE: NO NON-FUSED UNLESS NOTED "F" FUSED). USE "VD" 480 V.
6. HEIGHT MEASURED TO TOP OF THE BOX FROM FINISH FLOOR.
7. PROVIDE H.O.A. AND S.S. PUSHBUTTONS AS REQUIRED.
8. DOUBLE ARROWS DENOTE A DOUBLE FACE UNIT.
9. COORDINATE WITH MILLWORK SHOP DRAWINGS AND ELEVATIONS FOR HEIGHT.
10. SUBSCRIPT DENOTES NEMA CONFIGURATION.
11. HEIGHT MEASURED TO BOTTOM OF THE BOX FROM FINISH FLOOR.
12. COORDINATE WITH DOOR HARDWARE SUPPLIER.

SYMBOL	DESCRIPTION	MOUNTING HEIGHT	NOTES
○	CLOCK OUTLET	+9'-6"	8.
[FB]	FLOOR BOX - SEE SCHEDULE	FLOOR	SEE DIAGRAM, SPEC.
○	POKE THRU - SEE SCHEDULE	FLOOR	SEE DIAGRAM, SPEC.
○	JUNCTION BOX (F" IN FLOOR)	AS NOTED	
○	MOTOR OUTLET	TO SUIT EQUIP	
○	PUSHBUTTON	+4'-0"	2.
○	NON-FUSED DISCONNECT SWITCH	+5'-0"	5.
[F]	FUSED DISCONNECT SWITCH	+5'-0"	5.
[S]	MANUAL STARTER THERMAL OVERLOAD SWITCH WITH PILOT LIGHT	+4'-0"	2.
[M]	MAGNETIC STARTER	+5'-0"	7.
[M]	MAGNETIC STARTER / DISCONNECT COMBINATION	+5'-0"	7.
[VFD]	VARIABLE FREQUENCY DRIVE	+6'-6"	
[P]	PANEL BOARD	TOP AT +6'-0"	
[D]	MAIN DISTRIBUTION PANEL		
[T]	TELEPHONE TERMINAL BOARD		SEE SPECS
[G]	GROUND BUS BAR		
[E]	EQUIPMENT CABINET/RACK		CIRCUIT TO 120V
[B]	BELL	+7'-6"	
[F]	FIRE ALARM MANUAL STATION	+4'-0"	2.
[H]	FIRE ALARM SIGNAL HORN/STROBE	CEILING/ +8'-0"	6.
[S]	FIRE ALARM STROBE	+8'-0"	6.
[B]	FIRE ALARM SIGNAL STROBE WITH BLUE COLORED LENS (CO VISUAL ALARM)	CEILING/ +8'-0"	MOUNT AS PER. MFR.
○	ASPIRATING SMOKE DETECTION SYSTEM	CEILING	MOUNT AS PER. MFR.
○	SMOKE DETECTOR	CEILING	
○	CARBON MONOXIDE DETECTOR	CEILING	
○	HEAT DETECTOR	CEILING	
○	DUCT SMOKE DETECTOR	MTD. IN DUCT	
[D]	FIRE/SMOKE DAMPER		
[H]	DOOR HOLDER	AS NOTED	
[S]	FLOW SWITCH		
[S]	TAMPER SWITCH		
[W]	WATER FLOOD INDICATOR		
[V]	O.S. & Y. VALVE		SEE DIAGRAM
[R]	FIRE ALARM RELAY OR SECURITY RELAY		
[CM]	FIRE ALARM CONTROL MODULE		
[MM]	FIRE ALARM MONITOR MODULE		
[R]	ACCESS CONTROL MOMENTARY DOOR RELEASE BUTTON	AS NOTED	MOUNT AS PER. MFR.
[D]	SECURITY SYSTEM DOOR SWITCH	DOOR JAMB	
[R]	SECURITY REQUEST TO EXIT (REX)	AS REQ.	MOUNT AS PER. MFR.
[D]	SECURITY SYSTEM KEYPAD	+4'-0"	
[D]	SECURITY MOTION DETECTOR		MOUNT AS PER. MFR.
[D]	ELECTRIC DOOR STRIKE		12.
[D]	SECURITY SYSTEM POPIT	DOOR JAMB	MOUNT AS PER. MFR.
[D]	SECURITY SYSTEM SIREN		MOUNT AS PER. MFR.
[CR]	ACCESS CONTROL CARD READER	+4'-0"	
[H]	CAMERA - SEE SCHEDULE		AS NOTED
[A]	LIGHT FIXTURE (LETTER DESIGNATES TYPE)		
[E]	EQUIPMENT NUMBER		
[R2]	ARCHITECTURAL ROOM NUMBER		
[D]	DEVICE/EQUIPMENT (TEXT DESIGNATES TYPE)		
[D]	SEE SCHEDULE		
[D]	ACCESS CONTROL DOOR POSITION CONTACT	DOOR JAMB	
[D]	ACCESS CONTROL SPECIALTY POSITION CONTACT (ROOF HATCH, GARAGE DOOR)		
[D]	ACCESS CONTROL DURESS / PANIC BUTTON		MOUNT AS PER. MFR.

VOCO

SALT LAKE CITY - HQ
524 SOUTH 600 EAST
SALT LAKE CITY, UT 84102
801.575.8800
ST. GEORGE
20 N. MAIN ST. #103
ST. GEORGE, UT 84770
435.522.7070
VOCO.COM
VOCO NUMBER: 25315
CLIENT NUMBER: 17025
BNA



REV DATE DESCRIPTION
1 ADDENDUM Revision 1
M 1

BESD TREMONTON ELEMENTARY
2900 WEST & 500 NORTH, TREMONTON, UTAH
CONSTRUCTION DOCUMENTS

SYMBOLS, SCHEDULES AND NOTES

E001

1/6/2025 1:14 PM

1. DEVICE LOCATED IN GYMNASIUM.
2. DEVICE LOCATED IN DINING AREA.
3. SECURE DEVICE BEHIND DISPLAY.
4. DEVICE LOCATED IN FLOOR BOX.
5. ON/OFF SHALL ACTIVATE/DEACTIVATE THE SYSTEM IN THE DINING AREA. UPON ACTIVATION, LOCAL INPUTS SHALL BE ACTIVE AS WELL.
6. DEVICE LOCATED IN EQUIPMENT RACK.
7. MONI SUM THE OUTPUT OF THE CD PLAYER INTO THE DSP.
8. PROVIDE (1) STP CABLE FROM THIS LOCATION TO EACH COLLABORATION AREAS AND (1) STP CABLE TO EACH STEM LABS.
9. TERMINATE INTO PATCH PANEL. WITHIN EQUIPMENT RACK. LABEL EACH ENDPOINT WITH ROOM NAME & NUMBER.
10. ALSO DEVICE DEDICATED FOR GYMNASIUM AREA.
11. ALSO DEVICE DEDICATED FOR DINING AREA.
12. SECURE DEVICE ON TOP OF PROJECTOR.

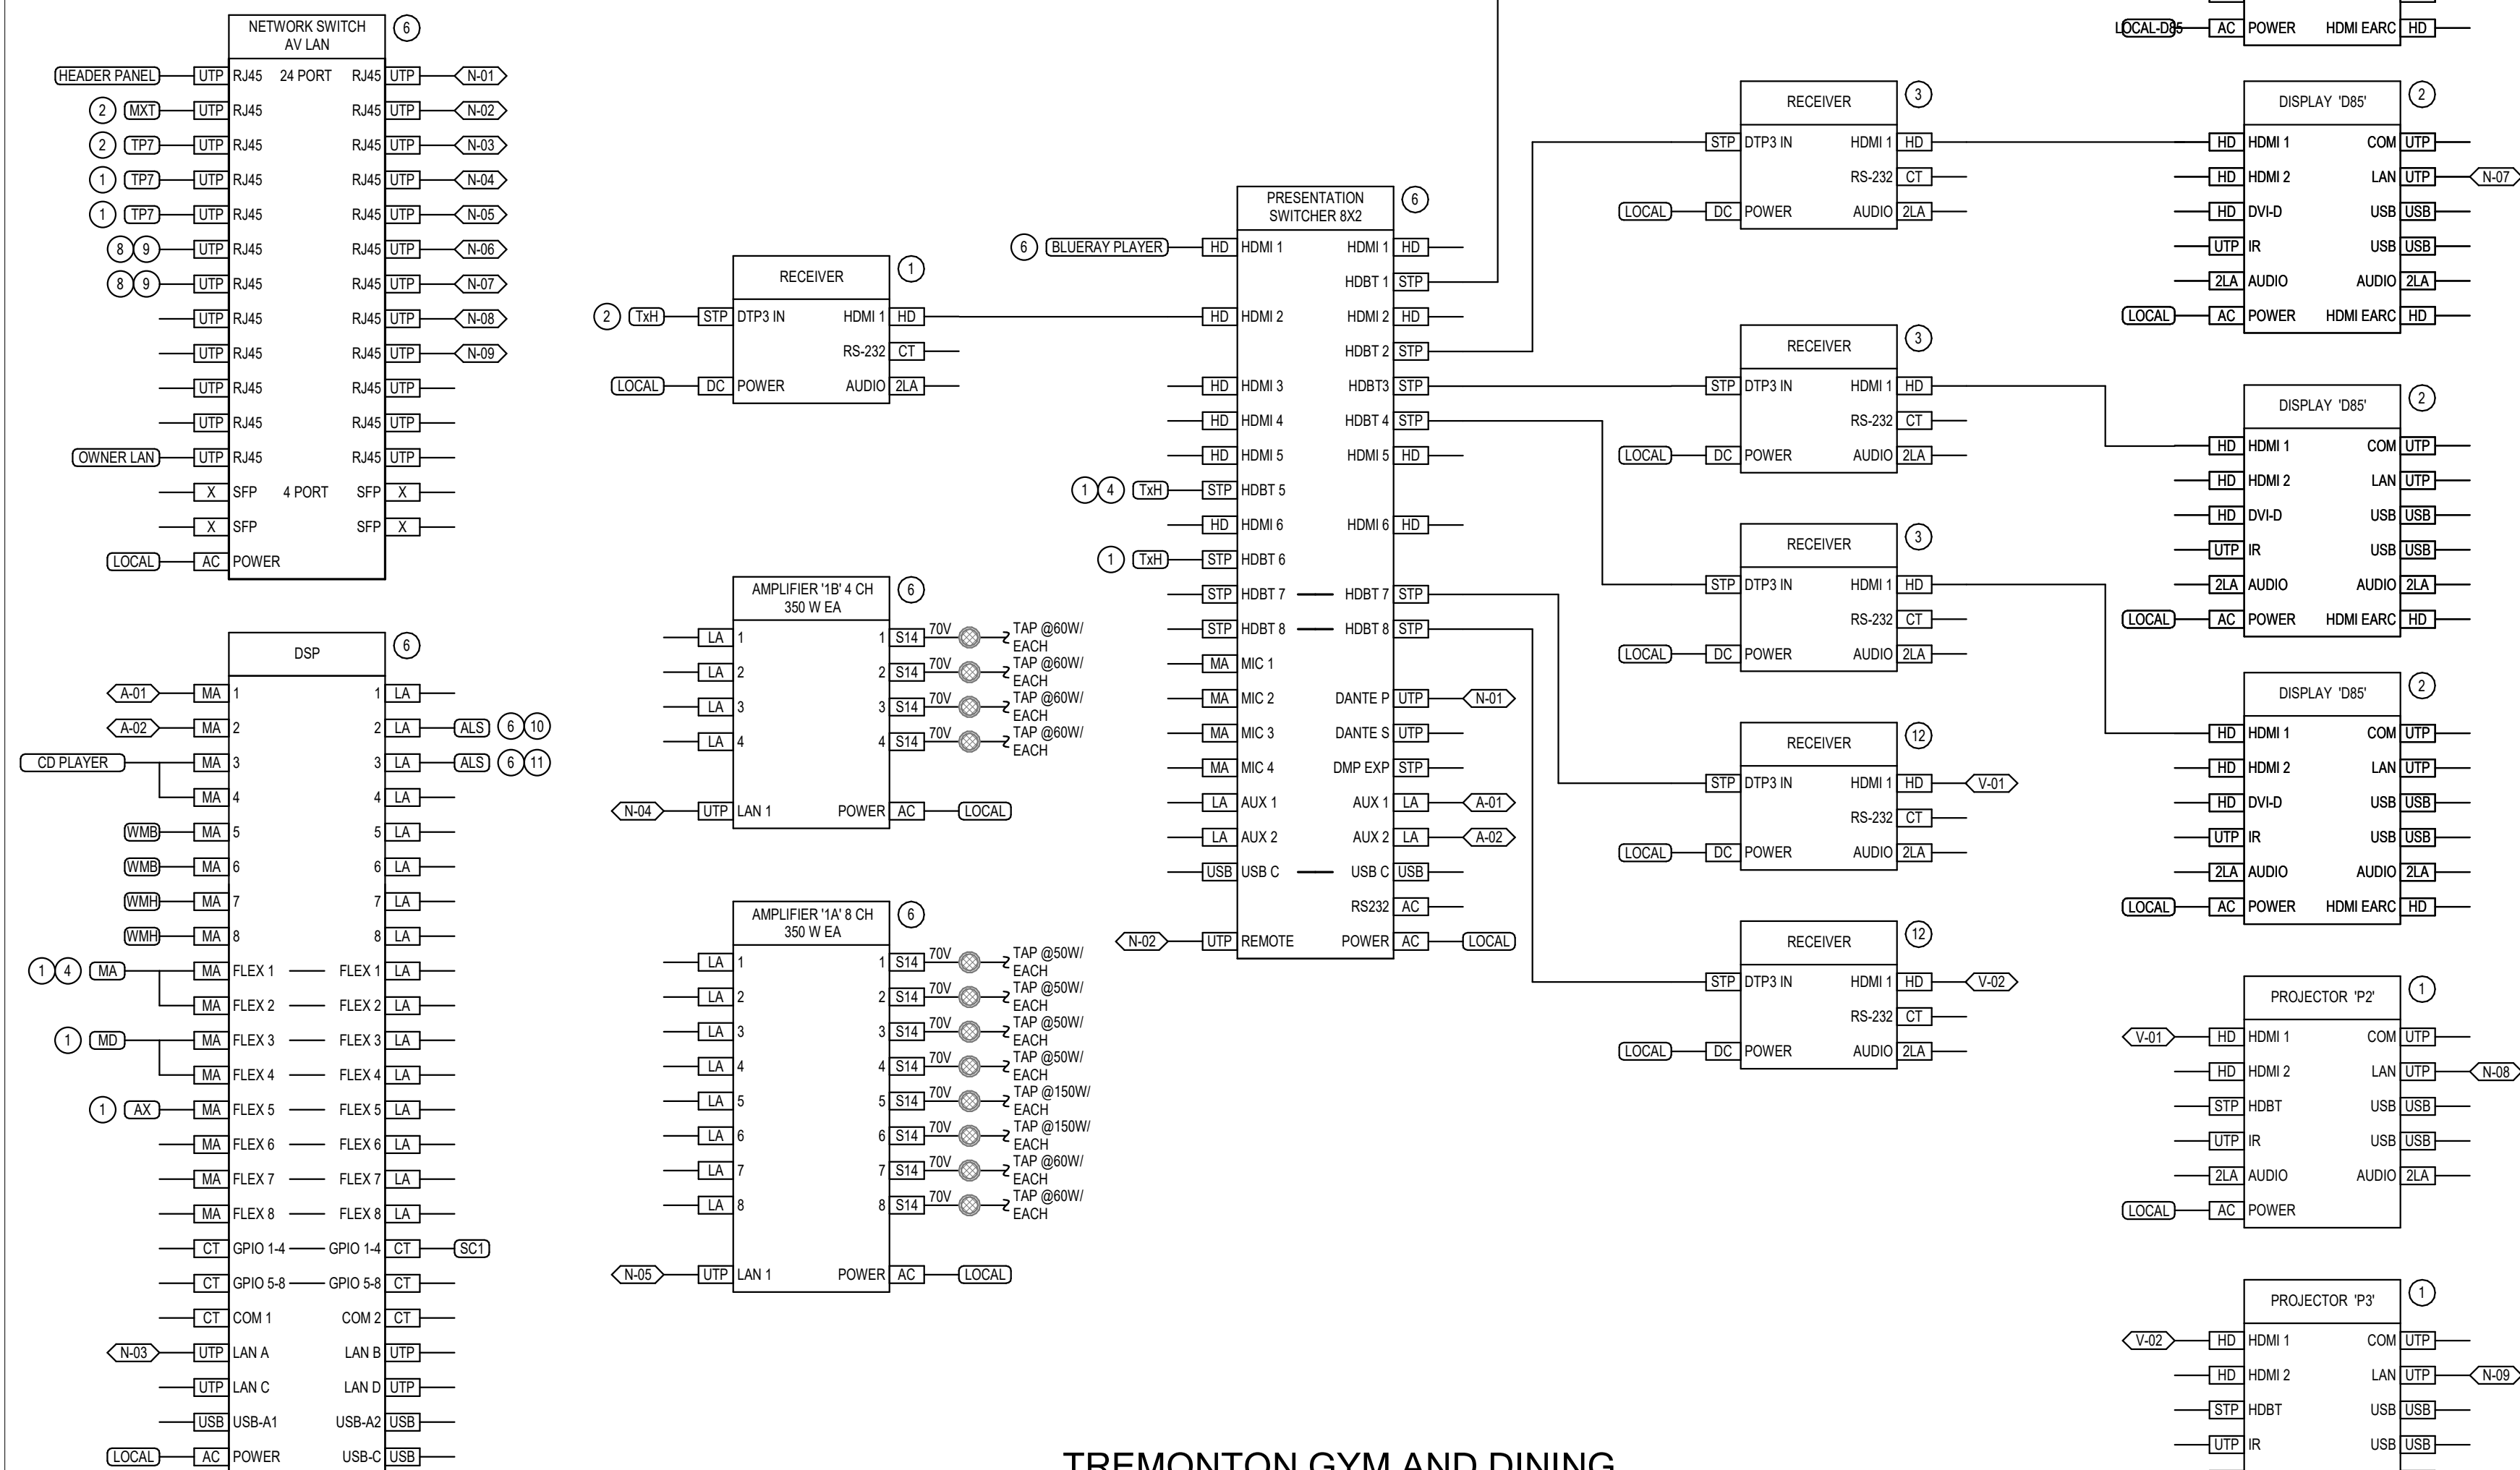


DIAGRAM V207 TREMONTON GYM AND DINING AUDIOVISUAL SIGNAL FLOW NTS

1. DEVICE LOCATED IN CEILING RACK.
2. SECURE DEVICE BEHIND DISPLAY.

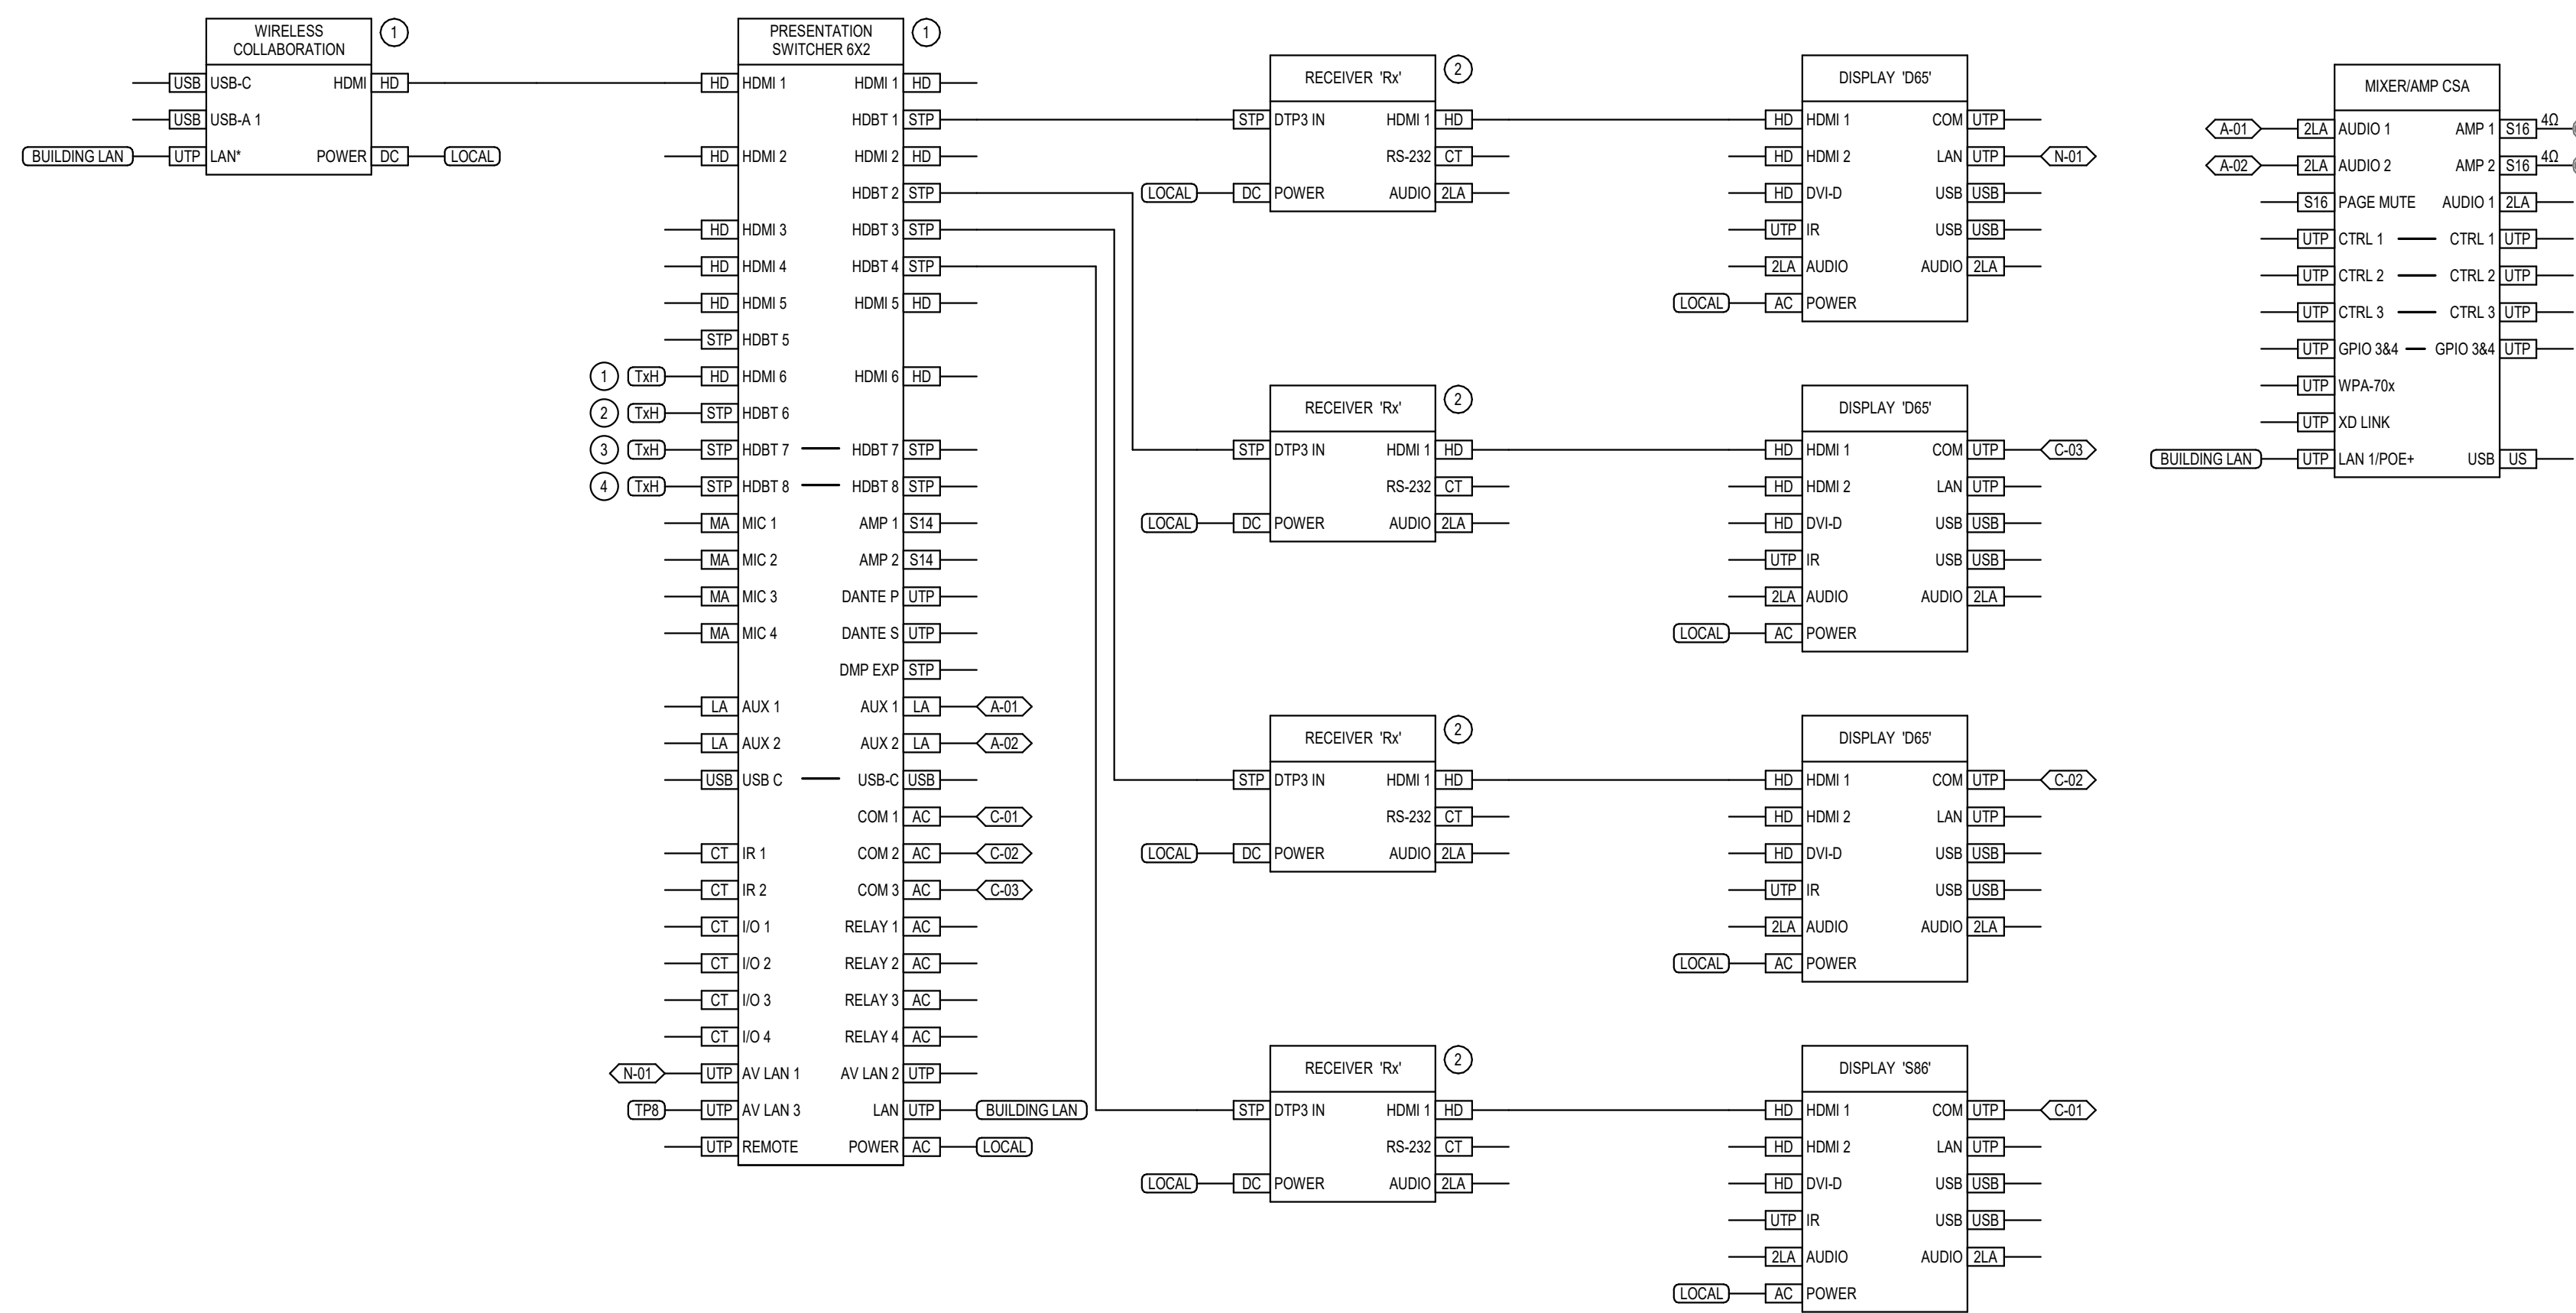


DIAGRAM V204 ART / STEM CLASSROOM AUDIOVISUAL SIGNAL FLOW NTS

1. DEVICE LOCATED IN EQUIPMENT RACK.

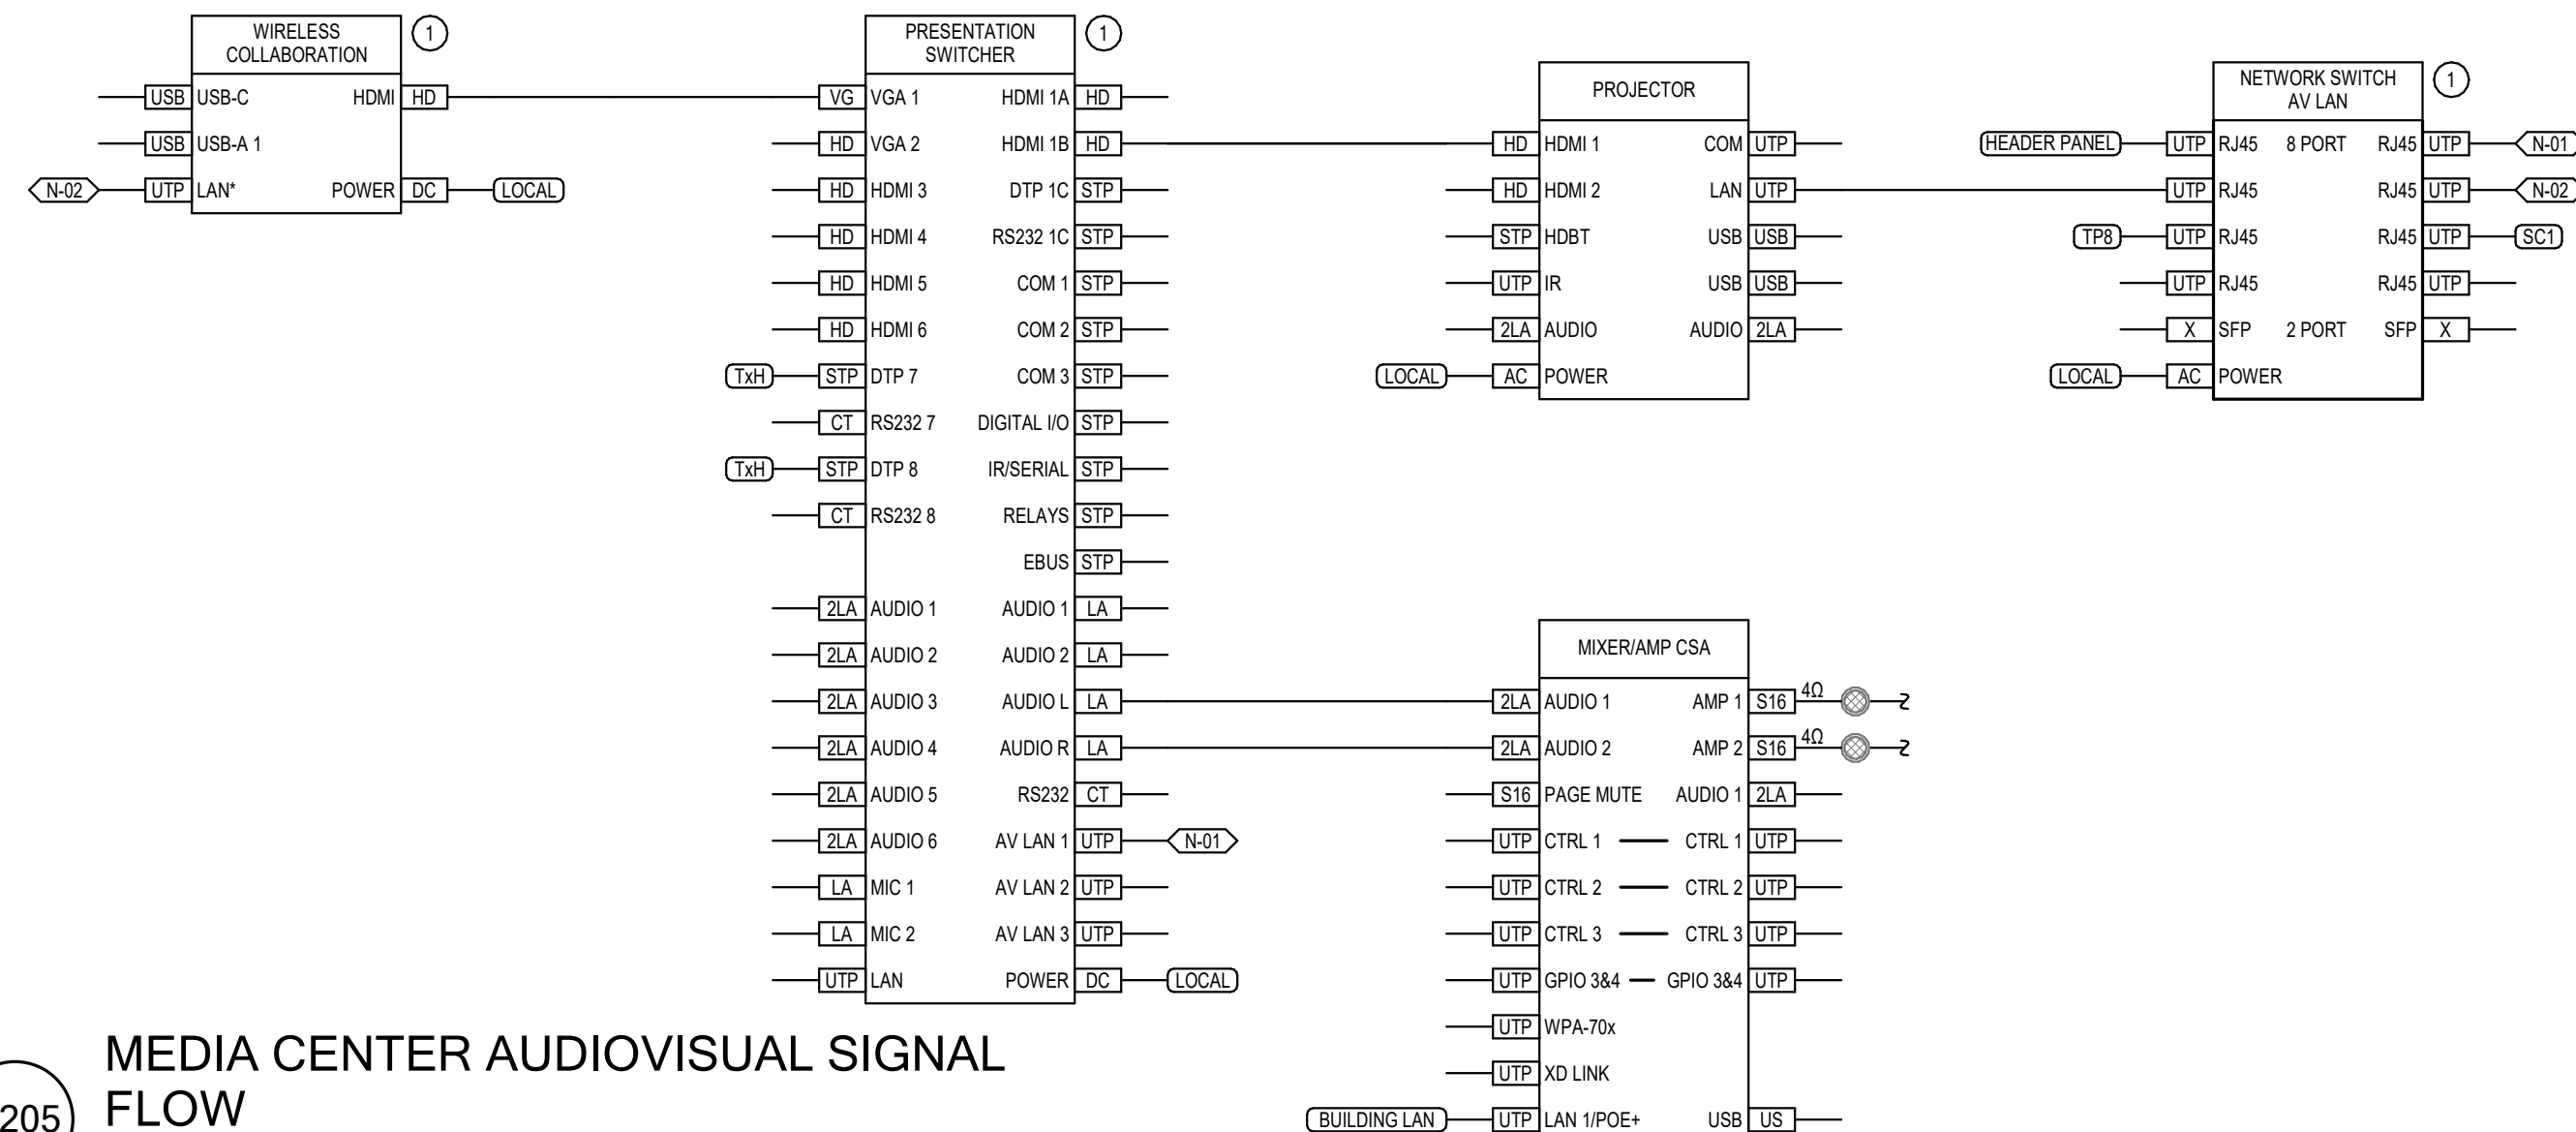


DIAGRAM V205 MEDIA CENTER AUDIOVISUAL SIGNAL FLOW NTS

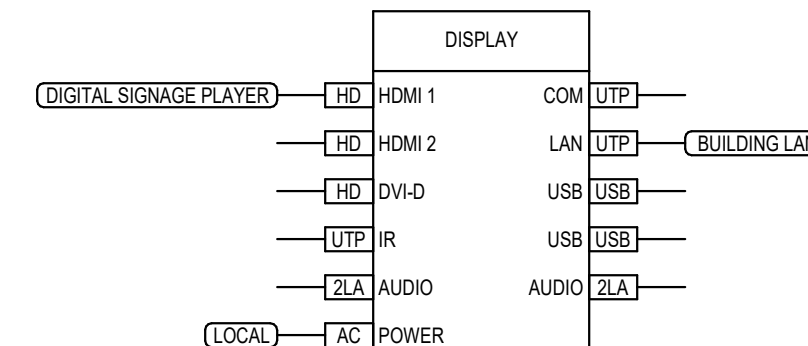


DIAGRAM V203 TYPICAL DISPLAY CONNECTION NTS

1. SECURE DEVICE BEHIND DISPLAY.

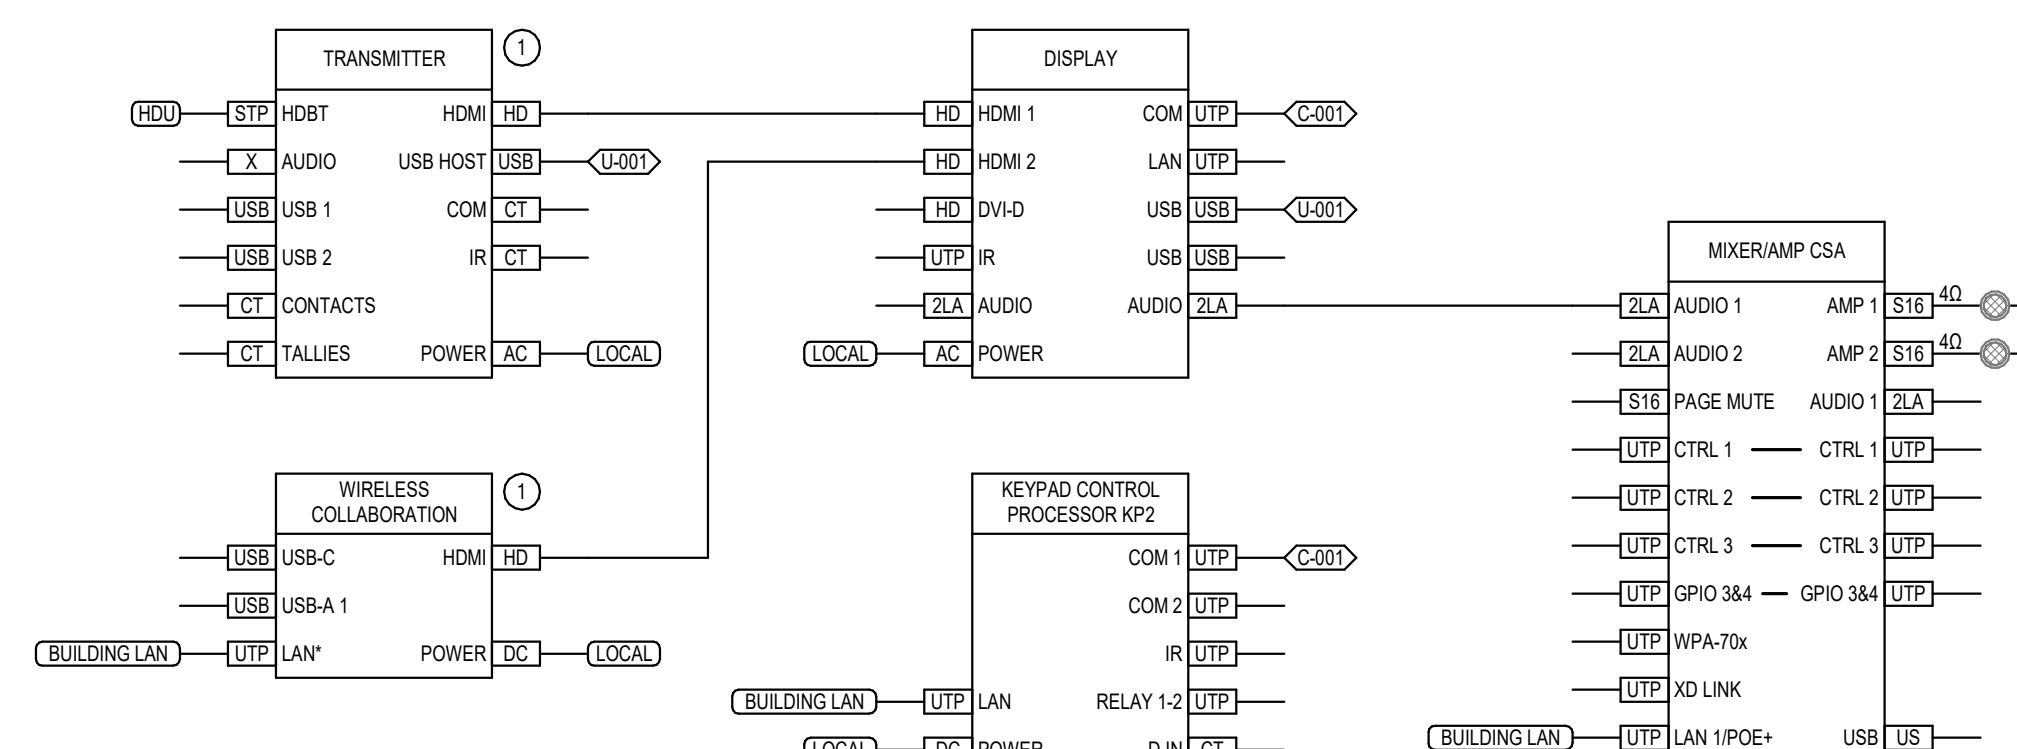


DIAGRAM V209 TYPICAL CLASSROOM AUDIOVISUAL SIGNAL FLOW NTS

1. SECURE DEVICE BEHIND DISPLAY.
2. SECURE DEVICE TO UNDERSIDE OF TABLE.
3. PROVIDE PROFESSIONAL GRADE HDMI/USB CABLES.

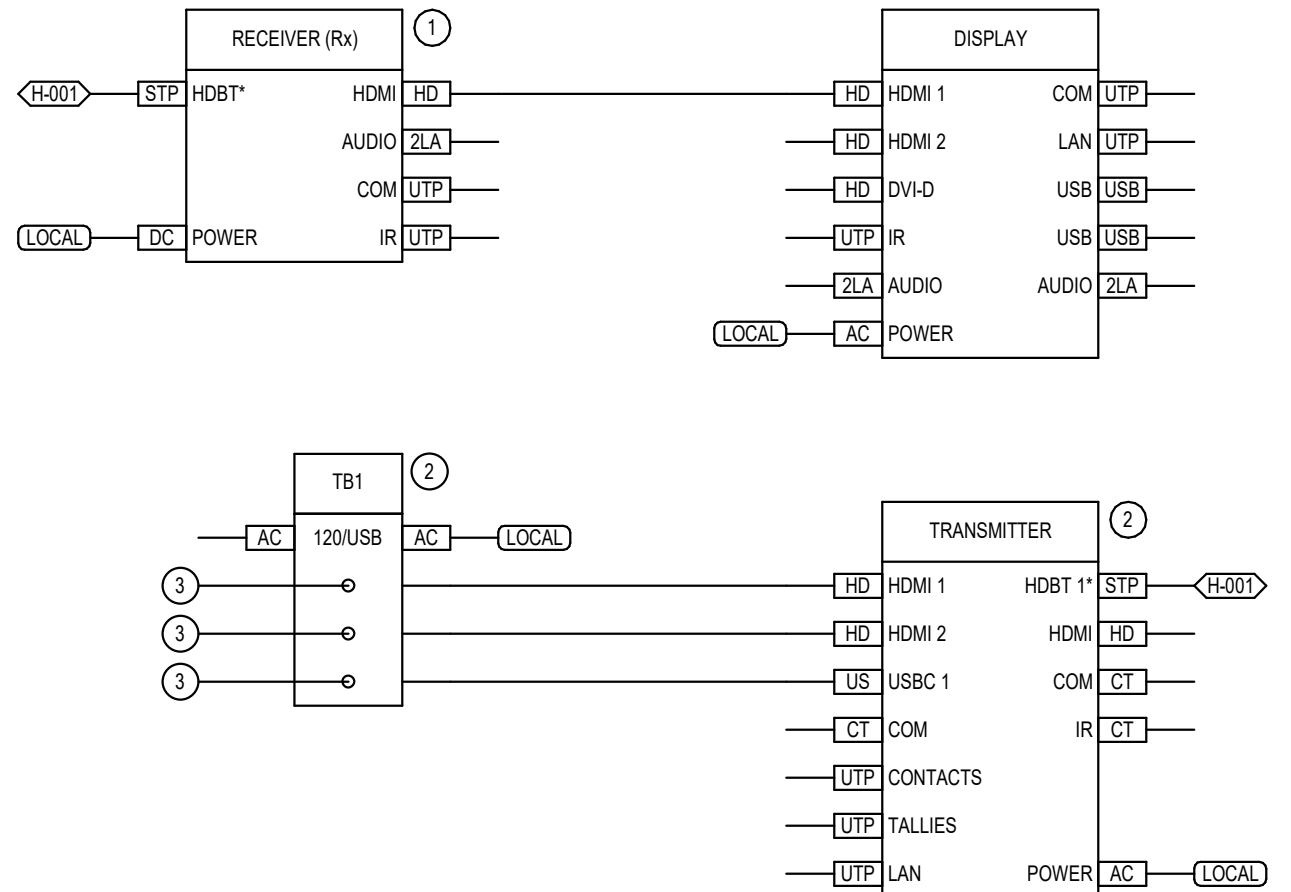



DIAGRAM V201 TYPICAL CONFERENCE ROOM AUDIOVISUAL SIGNAL FLOW NTS

VOCBO

SALT LAKE CITY - HQ
524 SOUTH 600 EAST
SALT LAKE CITY, UT 84102
801.575.8800

ST. GEORGE
20 N. MAIN ST. #103
ST. GEORGE, UT 84770
435.522.7070

VOCBO.COM
VOCBO NUMBER: 25315
CLIENT NUMBER: 17025
Designer

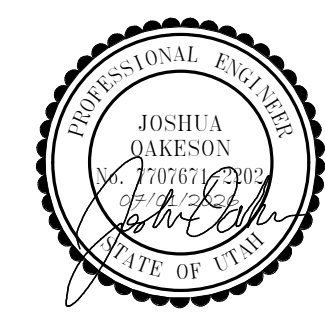

REV	DATE	DESCRIPTION
1	ADDENDUM M1	Revision 1

BESD TREMONTON ELEMENTARY

2900 WEST & 500 NORTH, TREMONTON, UTAH

CONSTRUCTION DOCUMENTS

AUDIOVISUAL DIAGRAMS

ET401

1/6/2025 1:51 PM



25315 - BESD TREMONTON ELEMENTARY
2900 West 500 North Tremonton, UT

Project No. 25315

Addendum

KADD-1.0

To: DWA Construction
76 W 2400 N, North Logan, UT 84341

Reason: Coordination

Date: **Fri July 10, 2026**

See the attached food service addendum from Jedrzewski Designs.

ADDENDUM 001

PRIOR APPROVALS

- SPEC SECTION 07 5420 THERMOPLASTIC MEMBRANE ROOFING
- VERSICO ROOF SYSTEMS

Kitchen:

Food Service
07/10/2026

See the attached food service addendum from
Jedrzewski Designs.

END OF KADD-1.0

Issued By: **Jedrzewski Designs, LLC.:** Ric Jedrzewski

cc:

Gerald Jackman
Nathan Tilley
Shane Wilde
Ric Jedrzewski
Drayton Bailey
Breanna Bonsavage
Justen Christensen
Pamela Irvine

Box Elder School District (BESD)
DWA Construction
DWA Construction
Jedrzewski Designs, LLC.
Resolut (Formerly VBFA + BNA)
VCBO Architecture
VCBO Architecture
VCBO Architecture

gerald.jackman@besd.net
nathan.t@dwaconstruct.com
shanew@dwaconstruct.com
ricj@jedrzewskidesigns.com
dbailey@resolutgroup.com
bbonsavage@vcbo.com
jrchristensen@vcbo.com
pirvine@vcbo.com



July 9, 2026

VCBO Project No. 25315

ADDENDUM #01

FOOD SERVICE EQUIPMENT

BESD TREMONTON ELEMENTARY SCHOOL

The following alternate manufacturer requests to the Section 114000 Food Service Equipment Specification are accepted or not accepted as noted below.

Requested Manufacturer Substitutions

- Hobart mixers → Globe mixers - **Not accepted**
- Hobart slicers → Globe slicers - **Not accepted**
- Hobart dishmachines → Champion dishmachines - **Not accepted**
- Metro Wire Shelving → Olympic/Centaur Wire Shelving - **Accepted**
- Metro Stainless shelving → Quantum Stainless shelving - **Accepted**
- New Age Bun Pan Racks → Winholt Bun Pan Racks - **Accepted**
- Kolpak Walk-In Boxes & Refrigeration → Norlake Walk-in Boxes & Refrigeration - **Accepted**
- Cres-Cor Heated Holding Cabinet → Carter-Hoffman Heated Holding Cabinet - **Not accepted**
- Traulsen refrigeration → True Spec Series refrigeration - **Accepted, stainless steel finish.**

Requested Model Series / Construction Substitutions

- Advance Tabco 7-PS-50 sink series → Advance Tabco 7-PS-EC sink series - **Accepted with full faucet and drain.**
- Blodgett DFG series convection oven → Blodgett Zephair Series Convection Oven - **Accepted**

END FOOD SERVICE EQUIPMENT ADDENDUM #01

Please refer all questions to:

Ric Jedrziwski

Jedrziwski Designs